



UDEM

Uluslar Arası Belgelendirme Denetim Eğitim Merkezi
San. Ve Tic. A.Ş.
Mutlukent Mahallesi 2073. Sokak No:10 Umitköy Çankaya-ANKARA



Test
TS EN ISO / IEC 17025
AB-1124-T

AB-1124-T

ULVD-029

05-19

LVD DENEY RAPORU LVD TEST REPORT

Sayfa(page) 1/80

Müşterinin adı/adresi : ALP ENERJİ SIST. BİL. VE İLET. TEKN. HİZ. SAN. TIC. LTD.
Customer name/address Yalı Mah. Top Selvi Cad. Mai Residence No: 100-B Daire:128 Kat:15 PK: 34873 Kartal / İSTANBUL

İstek Numarası : 090419-02
Order No.

Numunenin adı ve tarifi : AKÜ İZLEME SİSTEMİ
Name and identity of test item BATTERY MONITORING SYSTEM

Numunenin kabul tarihi : 09.04.2019
The date of receipt of test item

Açıklamalar : DGC'ye, TS EN 61010-1 standardı uyarınca testler uygulanmıştır.
Remarks EUT has been tested according to TS EN 61010-1 standard.

Deneğin yapıldığı tarih : 10.04.2019-20.05.2019
Date of Test

Raporun sayfa sayısı : 80
Number of pages of the Report

Deneğ laboratuvarı olarak faaliyet gösteren UDEM, TÜRKAK'tan AB-1124-T ile TS EN ISO/IEC 17025 Nisan 2012 standardına göre akredite edilmiştir.

UDEM accredited by TÜRKAK under registration number AB-1124-T for TS EN ISO/IEC 17025 April 2012 as test laboratory.

Türk Akreditasyon Kurumu(TÜRKAK) deneğ raporlarının tanınırlığı konusunda Avrupa Akreditasyon Birliğı(EA) ile Çok Taraflı Anlaşma ve Uluslararası Laboratuvar Akreditasyon Birliğı(ILAC) ile karşılıklı tanıma anlaşması imzalamıştır.

Turkish Accreditation Agency (TURKAK) is a signatory to the European co-operation for Accreditation (EA) Multilateral Agreement (MLA) and to the International Laboratory Accreditation Cooperation (ILAC) Mutual Recognition Arrangement (MRA) for the recognition of test reports.

Deneğ ve /veya ölçüm sonuçları, genişletilmiş ölçüm belirsizlikleri (olması halinde) ve deneğ metotları bu sertifikanın tamamlayıcı kısmı olan takip eden sayfalarda verilmiştir .

The test and/or measurement results, the uncertainties (if applicable) with confidence probability and test methods are given on the following pages which are part of this report.

Bu rapor, laboratuvara gönderilen numunelere uygulanan deneğ/deneğler sonucu hazırlanmıştır. Müşteriye ait diğere numuneleri kapsamaz.
This report was prepared according to test results of specimens sent to laboratory. It doesn't contain other specimens belonging to customer.

Mühür ve Tarih
Seal and Date



24.05.2019

Deneğ Sorumlusu
Person in charge of test

[Signature]
Onur KESKİN

Onaylayan
Approval

[Signature]
Erhan Engin ERTAŞ

Bu rapor, laboratuvarın yazılı izni olmadan kısmen kopyalanıp çoğaltılamaz. İmzasız ve mühürsüz raporlar geçersizdir.
This report shall not be reproduced other than in full except with the permission of the laboratory. Testing reports without signature and seal are not valid.



UDEM

Uluslar Arası Belgelendirme Denetim Eğitim Merkezi
San. Ve Tic. A.Ş.

AB-1124-T

ULVD-029

05-19

Sayfa(page) 2/80

İÇİNDEKİLER (CONTENTS)

Dökümantasyon (Documentation)	Sayfa (Page)
DGC, Çevre Şartları ve Sembollerin Tanımları (Description of the EUT, Environmental Conditions and Symbol Definitions)	3
Deney Standartları ve Bilgiler (Test Standards and Information)	4-8
Deney Sonuçları ve Koşulları (Test Results and Conditions)	9-75
Ekler (Attachments)	
DGC'nin Fotoğrafları (Photos of EUT)	76-80

Tadil No	Tadil Tarihi	Sayfa No	Tadilin Nedeni



UDEM

Uluslar Arası Belgelendirme Denetim Eğitim Merkezi
San. Ve Tic. A.Ş.

AB-1124-T

ULVD-029

05-19

Sayfa(page) 3/80

Deneyden Geçirilen Cihazın :

(Equipment Under Test's)

Markası : ALPAIS
(Brand)

Beyan Gücü : 24 W
(Rated Power)

Modeli : ALPAIS-B-ENV
(Model)

Beyan Gerilimi : 220-240 VAC
(Rated Voltage)

Seri Numarası : 1201-1809-001
(Serial Number)

Beyan Frekansı : 50 Hz
(Rated Frequency)

Tanımı :
(Description)

ALPAIS şarj edilebilir batarya(akü) ve akü paketlerinin akım, gerilim, sıcaklık gibi fiziksel parametrelerini izleyen ve bu değerleri kullanıcıya raporlayan, akü veya akü paketlerinin fiziksel değerlerini, belirlenen sınırlar içerisinde güvenli bir şekilde çalışması için gerekli tedbirleri alan sistemlerdir.

ALPAIS is a system that monitor the physical parameters of the rechargeable cells and battery pack, such as current, voltage, temperature and report these values to the user, and take the necessary measures for the safe operation of the physical values of the cells or battery pack within the specified limits.

Ürün Aile Grubu (Müşteri Beyanı);

Sayfa 80

Product Family Group (Customer Declaration);

Page 80

Cihaz BATMOD12(1101-1809-002) modülü ile birlikte test edilmiştir.

The device was tested with BATMOD12(1101-1809-002) module.

Modeller: BATMOD12(1101-XXXX-XXX), BATMOD02(1102-XXXX-XXX), BATMOD06(1103-XXXX-XXX)

(Models)

Açıklamalar:

Madde 12.3, 12.4, 12.5, 12,6 ve madde 13.2.3 akreditasyon kapsamı dışındadır.

Remarks

Clause 12.3, 12.4, 12.5, 12.6 and clause 13.2.3 are not included in accreditation.

Çevre Şartları :

(Environmental Conditions)

Deneyler sırasında ölçülen çevre şartları ilgili sayfalarda belirtilmiştir.

(The environmental conditions are measured during tests, are determined related pages.)

Sembollerin Tanımları :



(Definations of Symbols)

DGC = Deneyden geçen cihaz

(EUT = Equipment under test)

TEST REPORT IEC 61010-1 Safety requirements for electrical equipment for measurement, control, and laboratory use Part 1: General requirements	
Report Number	ULVD-029(05-19)
Date of issue	24.05.2019
Total number of pages	80
Applicant's name	ALP ENERJI SIST. BIL. VE ILET. TEKN. HIZ. SAN. TIC. LTD.
Address	Yalı Mah. Top Selvi Cad. Mai Residence No: 100-B Daire:128 Kat:15 PK: 34873 Kartal / İSTANBUL
Test specification:	
Standard	IEC 61010-1:2010 (Third Edition)
Test procedure	LVD
Non-standard test method	N/A
Test Report Form No	IEC61010_1J
Test Report Form(s) Originator	VDE Testing and Certification Institute
Master TRF	2013-11
<p>Copyright © 2013 Worldwide System for Conformity Testing and Certification of Electrotechnical Equipment and Components (IECEE), Geneva, Switzerland. All rights reserved.</p> <p>This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.</p> <p>If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.</p> <p>This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.</p>	
Test item description	Battery Monitoring System
Trade Mark	ALPAIS
Manufacturer	ALP ENERJI SIST. BIL. VE ILET. TEKN. HIZ. SAN. TIC. LTD.
Model/Type reference	ALPAIS-B-ENV
Ratings	220-240 VAC, 0,6A, 50Hz, 12VDC, 2A



Testing procedure and testing location:		
<input checked="" type="checkbox"/>	Testing Laboratory:	UDEM ULUSLARARASI BELGELENDİRME LVD LABORATUVARI
Testing location/ address		Mutlukent Mah. 2073 Sk. No:10 Ümitköy Çankaya ANKARA
Tested by (name + signature).....:		Onur KESKİN 
Approved by (name + signature).....:		Erhan Engin ERTAŞ 

Summary of testing:	
Clause	Comment



Test Report History:

This report may consist of more than one report and is valid only with additional or previous issued reports:

Ref. No.

Item

Tests performed (name of test and test clause):

Testing location:




Summary of compliance with National Differences

List of countries addressed:

The product fulfils the requirements of _____ (insert standard number and edition and delete the text in parenthesis or delete the whole sentence if not applicable)

Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBS that own these marks.

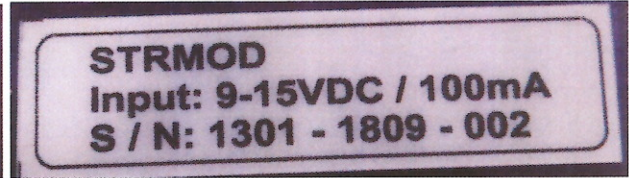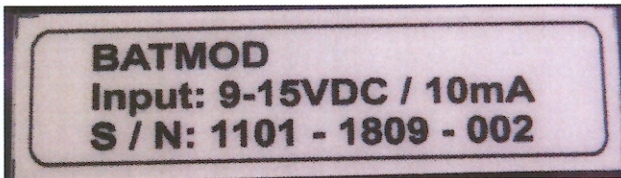

Test item particulars:

Type of item	Measurement / Control / Laboratory
Description of equipment function.....	ALPAIS is a system that monitor the physical parameters of the rechargeable cells and battery pack, such as current, voltage, temperature and report these values to the user, and take the necessary measures for the safe operation of the physical values of the cells or battery pack within the specified limits.
Connection to MAINS supply.....	Permanent / Detachable cord set / Non detachable cord set / None / Battery operated
Overvoltage category.....	II / III / IV
POLLUTION DEGREE	Pollution Degree II
Means of protection	Class I (PE connected) / Class II (isolated) / Class III
Environmental conditions	Normal / Extended (Specify): 0 - +50 °C
For use in wet locations.....	Yes / No
Equipment mobility	Portable / Hand-held / Floor-standing / Fixed / Built-in
Operating conditions.....	Continuous / Short-time / Intermittent
Overall size of equipment (W x D x H)cm.....	19 x 15 x 3.4
Mass of equipment (kg).....	0.5 Kg
Marked degree of protection to IEC 60529.....	-

Possible test case verdicts:

- Test case does not apply to the test object	N/A (Not Applicable)
- Test object does meet the requirement.....	P (Pass)
- Test object does not meet the requirement.....	F (Fail)

Testing:

Date of receipt of test item	09.04.2019
Date (s) of performance of tests	10.04.2019-20.05.2019

General remarks:

The test results presented in this report relate only to the object tested.
This report shall not be reproduced, except in full, without the written approval of the issuing testing laboratory.
"(see ENCLOSURE #)" refers to additional information appended to the report.
"(see Form A.xx)" refers to a table appended to the report.
Bottom lines for measurement tables Form A.xx are optional if used as record.

Throughout this report a comma / point is used as the decimal separator.

Manufacturer's Declaration per sub-clause 4.2.5 of IEC 60335-1:


The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided

Yes Not applicable

When differences exist; they shall be identified in the general product information section.




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
4	TESTS		—
4.4	Testing in SINGLE FAULT CONDITIONS		P
4.4.1	Fault tests	(see Form A.1)	P
4.4.2	Application of SINGLE FAULT CONDITIONS		P
4.4.2.1	SINGLE FAULT CONDITIONS not covered by 4.4.2.2 to 4.4.2.14	(see Form A.1)	—
4.4.2.2	PROTECTIVE IMPEDANCE		N/A
4.4.2.3	PROTECTIVE CONDUCTOR		N/A
4.4.2.4	Equipment or parts for short-term or intermittent operation		N/A
4.4.2.5	Motors		N/A
	– stopped while fully energized		—
	– prevented from starting		—
	– one phase interrupted (multi-phase)		—
4.4.2.6	Capacitors		N/A
4.4.2.7	MAINS transformers		N/A
4.4.2.7.2	Short circuit	(see Form A.39)	N/A
4.4.2.7.3	Overload	(see Form A.26B and A.40)	N/A
4.4.2.8	Outputs		P
4.4.2.9	Equipment for more than one supply		N/A
4.4.2.10	Cooling	(see Form A.26A)	N/A
	– air holes closed		N/A
	– fans stopped		N/A
	– coolant stopped		—
	– loss of cooling liquid		—
4.4.2.11	Heating devices		N/A
	– timer overridden		—
	– temperature controller overridden		—
4.4.2.12	Insulation between circuits and parts		P
4.4.2.13	Interlocks		N/A
4.4.2.14	Voltage selectors		N/A
4.4.3	Duration of tests	(see Form A.1)	—
4.4.4	Conformity after application of fault conditions	(see Form A.1; A.6, A.18)	P
5	MARKING AND DOCUMENTATION		—
5.1.1	Required equipment markings		—
	– visible from the exterior; or		P




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	– visible after removing cover or opening door		N/A
	– visible after removal from a rack or panel		N/A
	Not put on parts which can be removed by an operator		P
	Letter symbols (IEC 60027) used		P
	Graphic symbols (IEC 61010-1: Table 1) used		P
5.1.2	Identification		—
	Equipment is identified by:		—
	a) Manufacturer's or supplier's name or trademark	ALPAIS ALP ENERJI	P
	b) Model number, name or other means	Control Module	P
	Manufacturing location identified		N/A
5.1.3	MAINS supply		P
	Equipment is marked as follows:		—
	a) Nature of supply:		—
	1) a.c. RATED MAINS frequency or range of frequencies	50 Hz	—
	2) d.c. with symbol 1		—
	b) RATED supply voltage(s) or range.....	220-240 VAC	—
	c) Max. RATED power (W or VA) or input current.....	0,6 A	—
	The marked value not less than 90 % of the maximum value	(see Form A.2)	P
	If more than one voltage range:		—
	Separate values marked; or		N/A
	Values differ by less than 20 %	(see Form A.2)	N/A
	d) OPERATOR-set for different RATED supply voltages:		—
	Indicates the equipment set voltage	Not relevant	N/A
	Portable equipment indication is visible from the exterior		N/A
	Changing the setting changes the indication		N/A
	e) Accessory MAINS socket-outlets accepting standard MAINS plugs are marked:		—
	With the voltage if it is different from the MAINS supply voltage.....		—
	For use only with specific equipment		N/A
	If not marked for specific equipment it is marked with:		—
	The maximum rated current or power; or		N/A
	Symbol 14 with full details in the documentation		N/A
5.1.4	Fuses		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Operator replaceable fuse marking (see also 5.4.5)		—
5.1.5	TERMINALS, connections and operating devices		—
5.1.5.1	General		—
	Where necessary for safety, indication of purpose of TERMINALS, connectors, controls and indicators marked		P
	If insufficient space, symbol 14 used		N/A
	Push-buttons and actuators of emergency stop devices and indicators:		—
	– used only to indicate a warning of danger; or		N/A
	– the need for urgent action		N/A
	– coloured red		N/A
	– coded as specified in IEC 60073		N/A
	Supplementary means of coding provided, if meaning of colour relates (see IEC 60073):		—
	– to safety of persons; or		N/A
	– safety of the environment		N/A
5.1.5.2	TERMINALS		—
	MAINS supply TERMINAL identified		N/A
	Other TERMINAL marking:		—
	a) FUNCTIONAL EARTH TERMINALS (symbol 5 used)		N/A
	b) PROTECTIVE CONDUCTOR TERMINALS:		—
	Symbol 6 is placed close to or on the TERMINAL; or		N/A
	Part of appliance inlet		N/A
	c) TERMINALS of control circuits (symbol 7 used)		N/A
	d) HAZARDOUS LIVE TERMINALS supplied from the interior		N/A
	Standard MAINS socket outlet; or		N/A
	RATINGS marked; or		N/A
	Symbol 14 used		N/A
5.1.6	Switches and circuit breakers		—
	If disconnecting device, off position clearly marked		N/A
	If push-button used as power supply switch:		—
	– symbol 9 and 15 used for on-position		N/A
	– symbol 10 and 16 used for off-position		N/A
	– pair of symbols 9, 15 and 10, 16 close together		N/A
5.1.7	Equipment protected by DOUBLE INSULATION or REINFORCED INSULATION		P



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Protected throughout (symbol 11 used)		P
	Only partially protected (symbol 11 not used)		N/A
5.1.8	Field-wiring TERMINAL boxes		N/A
	If TERMINAL or ENCLOSURE exceeds 60 °C:	(see Form A.26A)	—
	Cable temperature RATING marked		—
	Marking visible before and during connection or beside TERMINAL		N/A
5.2	Warning markings		—
	Visible when ready for NORMAL USE		P
	Are near or on applicable parts		P
	Symbols and text correct dimensions and colour:		—
	a) symbols min 2,75 mm and text 1,5 mm high and contrasting in colour with background		P
	b) symbols and text moulded, stamped or engraved in material min. 2,0 mm high and		P
	0,5 mm depth or raised if not contrasting in colour		P
	If necessary marked with symbol 14		N/A
	Statement to isolate or disconnect if access by using a tool to HAZARDOUS LIVE parts is permitted		N/A
5.3	Durability of markings		—
	The required markings remain clear and legible in NORMAL USE	(see Form A.3)	P
5.4	Documentation		—
5.4.1	General		P
	Equipment is accompanied by documentation for safety purposes for OPERATOR or RESPONSIBLE BODY		P
	Safety documentation for service personnel authorized by the manufacturer		P
	Documentation necessary for safe operation is provided in printed media or		P
	in electronic media if available at any time		P
	Documentation includes:		—
	a) intended use		P
	b) technical specification		P
	c) name and address of manufacturer or supplier		P
	d) information specified in 5.4.2 to 5.4.6		P
	e) information to mitigate residual RISK (see also subclause 17)		N/A
	f) accessories for safe operation of the equipment specified		P




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	g) guidance provided to check correct function of the equipment, if incorrect reading may cause a HAZARD from harmful or corrosive substances of HAZARDOUS live parts		N/A
	h) instructions for lifting and carrying		P
	Warning statements and a clear explanation of warning symbols:		—
	– provided in the documentation; or		P
	– information is marked on the equipment		P
5.4.2	Equipment ratings		P
	Documentation includes:		—
	a) Supply voltage or voltage range	220-240V	—
	Frequency or frequency range.....	50 Hz	—
	Power or current rating	0,6 A	—
	b) Description of all input and output connections in accordance to 6.6.1 a)		P
	c) RATING of insulation of external circuits in accordance to 6.6.1 b)		N/A
	d) Statement of the range of environmental conditions (see 1.4)	0°C..50°C	P
	e) Degree of protection (IEC 60529)		N/A
	f) If impact rating less than 5 J:		—
	IK code in accordance to IEC 62262 marked; or		N/A
	symbol 14 of table 1 marked, with		N/A
	RATED energy level and test method stated		N/A
5.4.3	Equipment installation		—
	Documentation includes instructions for:		—
	a) assembly, location and mounting requirements		P
	b) protective earthing		N/A
	c) connections to supply		P
	d) PERMANENTLY CONNECTED EQUIPMENT:		—
	1) Supply wiring requirements		N/A
	2) If external switch or circuit-breaker, requirements and location recommendation		N/A
	e) ventilation requirements		N/A
	f) special services (e. g. air, cooling liquid)		N/A
	g) instructions relating to sound level		N/A
5.4.4	Equipment operation		—
	Instructions for use include:		—
	a) identification and description of operating controls		P




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	b) positioning for disconnection		P
	c) instructions for interconnection		P
	d) specification of intermittent operation limits		N/A
	e) explanation of symbols used		P
	f) replacement of consumable materials		N/A
	g) cleaning and decontamination		N/A
	h) listing of any poisonous or injurious gases and quantities		N/A
	i) RISK reduction procedures relating to flammable liquids (see 9.5)		N/A
	j) RISK reduction procedures relating burn from surfaces permitted to exceed limits of 10.1		N/A
	Additional precautions for IEC 60950 conforming equipment in regard to moistures and liquids		N/A
	A statement about protection impairment if used in a manner not specified by the manufacturer		N/A
5.4.5	Equipment maintenance and Service		—
	Instructions for RESPONSIBLE BODY include:		—
	Instructions sufficient in detail permitting safe maintenance and inspection and continued safety:		—
	Instruction against the use of detachable MAINS supply cord with inadequate rating		N/A
	Specific battery type of user replaceable batteries		N/A
	Any manufacturer specified parts		N/A
	Rating and characteristics of fuses		N/A
	Instructions include following subjects permitting safe servicing and continued safety:		—
	a) product specific RISKS may affect service personnel		N/A
	b) protective measures for these RISKS		N/A
	c) verification of the safe state after repair		N/A
5.4.6	Integration into systems or effects resulting from special conditions		N/A
	Aspects described in documentation		N/A


6	PROTECTION AGAINST ELECTRIC SHOCK		—
6.1	General	(see Form A.14 and A.15)	—
6.1.1	Requirements		—
	Protection against electric shock maintained in NORMAL CONDITION and SINGLE FAULT CONDITION		P
	ACCESSIBLE parts not HAZARDOUS LIVE		P




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Voltage, current, charge or energy below the limits in NORMAL CONDITION and in SINGLE FAULT CONDITION between:		—
	ACCESSIBLE parts and earth		N/A
	two ACCESSIBLE parts on same piece of the equipment within a distance of 1,8 m		N/A
	Conformity is checked by the determination of 6.2 and 6.3 followed by the tests of 6.4 to 6.11		P
6.1.2	Exceptions		—
	Following HAZARDOUS LIVE parts may be ACCESSIBLE to an OPERATOR:		—
	a) parts of lamps and lamp sockets after lamp removal		N/A
	b) parts to be replaced by OPERATOR only by the use of tool and warning marking		N/A
	Those parts not HAZARDOUS LIVE 10 s after interruption of supply	(see Form A.5)	N/A
	Capacitance test if charge is received from internal capacitor	(see Form A.4 and A.5)	N/A
6.2	Determination of ACCESSIBLE parts	(see Form A.4)	—
6.2.1	General		—
	Unless obviously determination of ACCESSIBLE parts as specified in 6.2.2 to 6.2.4	No Accessible Parts	N/A
6.2.2	Examination		—
	– with jointed test finger (as specified B.2)		P
	– with rigid test finger (as specified B.1) and a force of 10 N		N/A
6.2.3	Openings above parts that are HAZARDOUS LIVE		—
	– test pin with length of 100 mm and 4 mm in diameter applied		N/A
6.2.4	Openings for pre-set controls		—
	– test pin with length of 100 mm and 3 mm in diameter applied		N/A
6.3	Limit values for ACCESSIBLE parts		—
6.3.1	Levels in NORMAL CONDITION	(see Form A.5)	—
	a) Voltage limits less than 33 V r.m.s. and 46,7 V peak or 70 V d.c.		N/A
	for WET LOCATIONS voltage limits less than 16 V r.m.s. and 22,6 V peak or 35 V d.c.		N/A
	Voltages are not HAZARDOUS LIVE the levels of:		—
	b) Current less than 0,5 mA r.m.s. for sinusoidal, 0,7 mA peak non-sinusoidal or mixed frequencies or 2 mA d.c. when measured with measuring circuit A.1 or A.2 if less than 100 Hz		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	for WET LOCATIONS measuring circuit A.4 used		N/A
	70 mA r.m.s. when measured with circuit A.3 for higher frequencies		N/A
	or		—
	c) Levels of capacitive charge or energy less:		—
	1) 45 μ C for voltages up to 15 kV peak or d.c. or line A of Figure 3		N/A
	2) 350 mJ stored energy for voltages above 15 kV peak or d.c.		N/A
6.3.2	Levels in SINGLE FAULT CONDITION	(see Form A.6)	—
	a) Voltage limits less than 55 V r.m.s. and 78 V peak or 140 V d.c.		N/A
	for WET LOCATIONS voltage limits less than 33 V r.m.s. and 46,7 V peak or 70 V d.c.		N/A
	Voltages are not HAZARDOUS LIVE the levels of:		—
	b) Current less than 3,5 mA r.m.s. for sinusoidal, 5 mA peak non-sinusoidal or mixed frequencies or 15 mA d.c. when measured with measuring circuit A.1 or A.2 if less than 100 Hz		N/A
	for WET LOCATIONS measuring circuit A.4 used		N/A
	500 mA r.m.s. when measured with circuit A.3 for higher frequencies		N/A
	or		—
	c) Levels of capacitive charge or energy less line B of Figure 3		N/A
6.4	Primary means of protection		—
6.4.1	ACCESSIBLE parts prevented from being HAZARDOUS LIVE by one or more of following means:		—
	a) ENCLOSURES OR PROTECTIVE BARRIERS (see 6.4.2)		P
	b) BASIC INSULATION (see 6.4.3)		N/A
	c) Impedance (see 6.4.4)		N/A
6.4.2	ENCLOSURES OR PROTECTIVE BARRIERS	(see Form A.15 and A.16)	—
	– meet rigidity requirements of 8.1		P
	– meet requirements for BASIC INSULATION, if protection is provided by insulation		P
	– meet requirements of 6.7 for CREEPAGE and CLEARANCES between ACCESSIBLE parts and HAZARDOUS live parts, if protection is provided by limited access		P
6.4.3	BASIC INSULATION	(see Form A.15 and A.16)	—
	– meet CLEARANCE, CREEPAGE DISTANCE and solid insulation requirements of 6.7		N/A
6.4.4	Impedance	(see Form A.12 and A.15)	—




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Impedance used as primary means of protection meets all of following requirements:		—
	a) limits current or voltage to level of 6.3.2	(see Form A.6)	N/A
	b) RATED for maximum WORKING VOLTAGE and the amount of power it will dissipate		N/A
	c) CLEARANCE, CREEPAGE DISTANCE between terminations of the impedance meet requirements of BASIC INSULATION of 6.7	(see Form A.15)	N/A
6.5	Additional means of protection in case of SINGLE FAULT CONDITION		—
6.5.1	ACCESSIBLE parts are prevented from becoming HAZARDOUS live by the primary means of protection and supplemented by one of:		—
	a) PROTECTIVE BONDING (see 6.5.2)		N/A
	b) SUPPLEMENTARY INSULATION (see 6.5.3)		N/A
	c) automatic disconnection of the supply (see 6.5.5)		N/A
	d) current- or voltage-limiting device (see 6.5.6)		N/A
	Alternatively one of the single means of protection is used:		—
	e) REINFORCED INSULATION (see 6.5.3)		N/A
	f) PROTECTIVE IMPEDANCE (see 6.5.4)		N/A
6.5.2	PROTECTIVE BONDING	(see Form A.7, A.8, A.9, A.10 or A.11)	—
6.5.2.1	ACCESSIBLE conductive parts, may become HAZARDOUS LIVE in SINGLE FAULT CONDITION:		—
	Bonded to the PROTECTIVE CONDUCTOR TERMINAL; or		N/A
	Separated by conductive screen or barrier bonded to PROTECTIVE CONDUCTOR TERMINAL		N/A
6.5.2.2	Integrity of PROTECTIVE BONDING		—
	a) PROTECTIVE BONDING consists of directly connected structural parts or discrete conductors or both; and withstands thermal and dynamic stresses		N/A
	b) Soldered connections:		—
	Independently secured against loosening		N/A
	Not used for other purposes		N/A
	c) Screw connections are secured		N/A
	d) PROTECTIVE BONDING not interrupted; or		N/A
	exempted as removable part carries MAINS SUPPLY input connection		N/A
	e) Any movable PROTECTIVE BONDING connection specifically designed, and meets 6.5.2.4		N/A
	f) No external metal braid of cables used (not regarded as PROTECTIVE BONDING)		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	g) IF MAINS SUPPLY passes through:		—
	Means provided for passing protective conductor;		N/A
	Impedance meets 6.5.2.4		N/A
	h) Protective conductors bare or insulated, if insulated, green/yellow		N/A
	Exceptions:		—
	1) earthing braids;		N/A
	2) internal protective conductors etc.;		N/A
	Green/yellow not used for other purposes		N/A
	TERMINAL suitable for connection of a PROTECTIVE CONDUCTOR, and meets 6.5.2.3		N/A
6.5.2.3	PROTECTIVE CONDUCTOR TERMINAL		—
	a) Contact surfaces are metal		N/A
	b) Appliance inlet used		N/A
	c) For rewirable cords and PERMANENTLY CONNECTED EQUIPMENT, PROTECTIVE CONDUCTOR TERMINAL is close to MAINS supply TERMINALS		N/A
	d) If no MAINS supply is required, any PROTECTIVE CONDUCTOR TERMINAL:		—
	Is near terminals of circuit for which protective earthing is necessary		N/A
	External if other terminals external		N/A
	e) Equivalent current-carrying capacity to MAINS supply TERMINALS	(see Form A.7)	N/A
	f) If plug-in, makes first and breaks last		N/A
	g) If also used for other bonding purposes, PROTECTIVE CONDUCTOR:		—
	Applied first;		N/A
	Secured independently;		N/A
	Unlikely to be removed by servicing		N/A
	h) PROTECTIVE CONDUCTOR of measuring circuit:		—
	1) Current RATING equivalent to measuring circuit TERMINAL;		N/A
	2) PROTECTIVE BONDING: not interrupted by any switch or interrupting device		N/A
	i) FUNCTIONAL EARTH TERMINALS allow independent connection		N/A
	j) If a binding screw used for PROTECTIVE CONDUCTOR TERMINAL:		—
	Suitable size for bond wire		N/A
	Not smaller than M 4		N/A
	At least 3 turns of screw engaged		N/A




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Passes tightening torque test	(see Form A.8)	N/A
	k) Contact pressure not capable being reduced by deformation of materials		N/A
6.5.2.4	Impedance of PROTECTIVE BONDING of plug-connected equipment	(see Form A.9)	—
	Impedance between PROTECTIVE CONDUCTOR TERMINAL and each ACCESSIBLE part where PROTECTIVE BONDING is specified, is:		—
	– less than 0,1 Ohm; or		N/A
	– less than 0,2 Ohm if equipment is provided with non-detachable cord		N/A
6.5.2.5	Bonding impedance of PERMANENTLY CONNECTED EQUIPMENT	(see Form A.10)	—
6.5.2.6	Transformer PROTECTIVE BONDING screen	(see Form A.11)	—
	Transformer provided with screen for PROTECTIVE BONDING:		—
	screen bonding consists of directly connected structural parts or discrete conductors or both; and withstands thermal and dynamic stresses (see 6.5.2.2 a)		N/A
	screen bonding with soldered connection (see 6.5.2.2 b) is:		N/A
	– Independently secured against loosening		N/A
	– Not used for other purposes		N/A
6.5.3	SUPPLEMENTARY and REINFORCED INSULATION		—
	Meet CLEARANCE, CREEPAGE DISTANCE and solid insulation requirements of 6.7		N/A
6.5.4	PROTECTIVE IMPEDANCE	(see Form A.12)	—
	Limits current or voltage to level of 6.3.1 in NORMAL and to level of 6.3.2 in SINGLE FAULT CONDITION		N/A
	CLEARANCE, CREEPAGE DISTANCE between terminations of the impedance meet requirements of DOUBLE or REINFORCED INSULATION of 6.7	(see Form A.15)	N/A
	The PROTECTIVE IMPEDANCE consists of one or more of the following:	(see TABLE 1 and Form A.12)	—
	a) appropriate single component suitable for safety and reliability for protection, it is:		—
	1) RATED twice the maximum WORKING VOLTAGE		N/A
	2) resistor RATED for twice the power dissipation for maximum WORKING VOLTAGE		N/A
	b) combination of components		N/A
	Single electronic device not used as PROTECTIVE IMPEDANCE		N/A
6.5.5	Automatic disconnection of the supply		—




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	a) RATED to disconnect the load within time specified in Figure 2		N/A
	b) RATED for the maximum load conditions of the equipment		N/A
6.5.6	Current- or voltage-limiting devices	(see Form A.12)	—
	Device complies with all of:		—
	a) RATED to limit the current or voltage to the level of 6.3.2	(see Form A.6)	N/A
	b) RATED for the maximum WORKING VOLTAGE; and		N/A
	RATED for the maximum operational current if applicable		N/A
	c) CLEARANCE, CREEPAGE DISTANCE between terminations of the impedance meet requirements of SUPPLEMENTARY INSULATION of 6.7	(see Form A.14, A.15)	N/A
6.6	Connections to external circuits		—
6.6.1	Connections do not cause ACCESSIBLE parts of the following to become HAZARDOUS LIVE in NORMAL CONDITION or SINGLE FAULT CONDITION:		—
	– the external circuits		P
	– the equipment		P
	Protection achieved by separation of circuits; or		P
	short circuit of separation does not cause a HAZARD		N/A
	Instructions or markings for each terminal include:		—
	a) RATED conditions for TERMINAL		N/A
	b) Required RATING of external circuit insulation		P
6.6.2	TERMINALS for external circuits		—
	TERMINALS which receive a charge from an internal capacitor are not HAZARDOUS LIVE after 10 s of interrupting supply connection	(see Form A.5)	N/A
6.6.3	Circuits with terminals which are HAZARDOUS LIVE		—
	These circuits are:		—
	Not connected to ACCESSIBLE conductive parts; or		N/A
	Connected to ACCESSIBLE conductive parts, but are not MAINS CIRCUITS and have one TERMINAL contact at earth potential		N/A
	No ACCESSIBLE conductive parts are HAZARDOUS LIVE		N/A
6.6.4	ACCESSIBLE terminals for stranded conductors		—
	No RISK of accidental contact because:		—
	– Located or shielded		N/A
	– Self-evident or marked whether or not connected to ACCESSIBLE conductive parts	Unit is located in a rack panel which is closed, so no live parts are accessible	N/A




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	ACCESSIBLE TERMINALS will not work loose		N/A
6.7	Insulation requirements	(see Form A.14)	P
6.7.1	The nature of insulation		—
6.7.1.1	Insulation between ACCESSIBLE parts or between separate circuits consist of CLEARANCES, CREEPAGE DISTANCES and solid insulation if provided as protection against a HAZARD	Reinforced Insulation	P
6.7.1.2	CLEARANCES		—
	Required CLEARANCES reflecting factors of 6.7.1.1	(see Form A.14 and A.15)	P
	Equipment rated for operating altitude greater than 2000 m correction factor of Table 3 of 61010-1 applied		N/A
6.7.1.3	CREEPAGE DISTANCES		—
	Required CREEPAGE DISTANCES reflecting factors of 6.7.1.1 a) to d)	(see Form A.14 and A.15)	P
	CTI material group reflected by requirements	IIIb	P
	CTI test performed		N/A
6.7.1.4	Solid insulation		—
	Required solid insulation reflecting factors of 6.7.1.1 a) to d)	(see Form A.14 and A.15)	N/A
6.7.1.5	Requirements for insulation according to type of circuit	(see Form A.14 and A.15)	—
	a) 6.7.2 MAINS circuits of OVERVOLTAGE CATEGORY II up to nominal supply voltage of 300 V	Approved Adaptor	N/A
	b) 6.7.3 secondary circuits separated from circuits defined in a) by transformer		N/A
	c) K.1 MAINS circuits of OVERVOLTAGE CATEGORY III and IV or OVERVOLTAGE CATEGORY II over 300 V		N/A
	d) K.2 secondary circuits separated from circuits defined in c) by transformer		P
	e) K.3 circuits having one or more of:		—
	1) maximum TRANSIENT OVERVOLTAGE is limited to known level below the level of MAINS CIRCUIT		N/A
	2) maximum TRANSIENT OVERVOLTAGE above the level of MAINS CIRCUIT		N/A
	3) WORKING VOLTAGE is the sum of more than one circuit or a mixed voltage		N/A
	4) WORKING VOLTAGE includes recurring peak voltage, may include non-sinusoidal or non-periodic waveform		N/A
	5) WORKING VOLTAGE with a frequency above 30 kHz		N/A
6.7.2	Insulation for MAINS CIRCUITS of OVERVOLTAGE CATEGORY II with a nominal supply voltage up to 300 V		—
6.7.2.1	CLEARANCES and CREEPAGE DISTANCES	(see Form A.14 and A.15)	—




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Values for MAINS CIRCUITS of Table 4 are met		N/A
	Coatings to achieve reduction to POLLUTION DEGREE 1 comply with requirements of Annex H		N/A
6.7.2.2	Solid insulation		—
6.7.2.2.1	Withstands electrical and mechanical stresses in normal use and all RATED environmental conditions of 1.4		P
	Equipment passed voltage tests of 6.8.3 with values of Table 5	(see Form A.18)	P
	Complies as applicable:		—
	a) ENCLOSURE or PROTECTIVE BARRIER of Clause 8		P
	b) moulded and potted parts requirements of 6.7.2.2.2		N/A
	c) inner layers of printed wiring boards requirements of 6.7.2.2.3		P
	d) thin-film insulation requirements of 6.7.2.2.4		N/A
6.7.2.2.2	Moulded and potted parts		—
	Conductors between same two layers are separated by at least 0,4 mm after moulding is completed		N/A
6.7.2.2.3	Inner insulating layers of printed wiring boards		—
	Separated by at least 0,4 mm between same two layers		P
	REINFORCED INSULATION have adequate electric strength; one of following methods used:		—
	a) thickness of insulation is at least 0,4 mm		P
	b) insulation is assembled of minimum two separate layers, each RATED for test voltage of Table 5 for BASIC INSULATION		N/A
	c) insulation is assembled of minimum two separate layers, where the combination is rated for test voltage of Table 5 for REINFORCED INSULATION		N/A
6.7.2.2.4	Thin-film insulation		—
	Conductors between same two layers are separated by applicable CLEARANCES and CREEPAGE DISTANCE of 6.7.2.1		N/A
	REINFORCED INSULATION have adequate electric strength; one of following methods used:		—
	a) thickness through the insulation at least 0,4 mm		N/A
	b) insulation is assembled of min two separate layers, each RATED for test voltage of Table 5 for BASIC INSULATION		N/A
	c) insulation is assembled of min three separate layers, where the combination of two layers passed voltage tests of 6.8.3 with values of Table 5 for REINFORCED INSULATION	(see Form A.18)	N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
6.7.3	Insulation for secondary circuits derived from MAINS CIRCUITS of OVERVOLTAGE CATEGORY II up to 300 V		—
6.7.3.1	Secondary circuits where separation from MAINS CIRCUITS is achieved by a transformer providing:		—
	– REINFORCED INSULATION		P
	– DOUBLE INSULATION		N/A
	– screen connected to the PROTECTIVE CONDUCTOR TERMINAL		N/A
6.7.3.2	CLEARANCES		—
	a) meet the values of Table 6 for BASIC INSULATION and SUPPLEMENTARY INSULATION; or		P
	twice the values of Table 6 for REINFORCED INSULATION		P
	or		—
	b) pass the voltage tests of 6.8 with values of Table 6;	(see Form A.18)	—
	with following adjustments:		—
	1) values for reinforced insulation are 1,6 times the values for basic insulation		P
	2) if operating altitude is greater than 2000 m values of CLEARANCES multiplied with factor of Table 3		N/A
	3) minimum CLEARANCE is 0,2 mm for POLLUTION DEGREE 2 and 0,8 mm for POLLUTION DEGREE 3		P
6.7.3.3	CREEPAGE DISTANCES		—
	Based on WORKING VOLTAGE meets the values of Table 7 for BASIC and SUPPLEMENTARY INSULATION	Basic	P
	Values for REINFORCED INSULATION are twice the values of BASIC INSULATION		N/A
	Coatings to achieve reduction to POLLUTION DEGREE 1 comply with requirements of Annex H		N/A
6.7.3.4	Solid insulation		—
6.7.3.4.1	Withstands electrical and mechanical stresses in normal use and all RATED environmental conditions of 1.4		—
	a) Equipment passed voltage test of 6.8.3.1 for 5 s with VALUES of Table 6 for BASIC and SUPPLEMENTARY INSULATION	(see Form A.18)	N/A
	values for REINFORCED INSULATION are 1,6 times the values of BASIC INSULATION		N/A
	b) if WORKING VOLTAGE exceeds 300 V, equipment passed voltage test of 6.8.3.1 for 1 min with a test voltage of 1,5 times working voltage for BASIC or SUPPLEMENTARY INSULATION	(see Form A.18)	N/A
	value for REINFORCED INSULATION are twice the WORKING VOLTAGE		N/A




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Complies as applicable:		—
	1) ENCLOSURE or PROTECTIVE BARRIER of Clause 8		N/A
	2) moulded and potted parts requirements of 6.7.3.4.2		N/A
	3) inner layers of printed wiring boards requirements of 6.7.3.4.3		N/A
	4) thin-film insulation requirements of 6.7.3.4.4		N/A
6.7.3.4.2	Moulded and potted parts		—
	Conductors between same two layers are separated by applicable distances of Table 8		N/A
6.7.3.4.3	Inner insulation layers of printed wiring boards		—
	Separated by at least by applicable distances of Table 8 between same two layers		N/A
	REINFORCED INSULATION have adequate electric strength; one of following methods used:		—
	a) thickness at least applicable distance of Table 8		N/A
	b) insulation is assembled of minimum two separate layers, each RATED for test voltage of Table 6 for BASIC INSULATION		N/A
	c) insulation is assembled of min two separate layers, where the combination is RATED for 1,6 times the test voltage of Table 6		N/A
6.7.3.4.4	Thin-film insulation		—
	Conductors between same two layers are separated by applicable CLEARANCES and CREEPAGE DISTANCE of 6.7.3.2 and 6.7.3.3		N/A
	REINFORCED INSULATION have adequate electric strength; one of following methods used:		—
	a) thickness at least applicable distance of Table 8		N/A
	b) insulation is assembled of min. two separate layers, each RATED for test voltage of Table 6 for BASIC INSULATION		N/A
	c) insulation is assembled of min. three separate layers, where the combination of two layers passed voltage tests with 1,6 time values of Table 6:	(see Form A.18)	—
	a.c. test of 6.8.3.1; or		N/A
	d.c. test of 6.8.3.2 for circuits stressed only by d.c. voltages		N/A
6.8	Procedure for dielectric strength tests	(see Form A.14 and A.18)	P
6.9	Constructional requirements for protection against electric shock		—
6.9.1	If a failure could cause a HAZARD:		—
	a) security of wiring connections		P



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	b) screws securing removable covers		P
	c) accidental loosening		P
	d) CLEARANCES and CREEPAGE DISTANCES not reduced below the values of basic insulation by loosening of parts or wires		P
6.9.2	Insulating materials		—
	Material not to be used for safety relevant insulation:		—
	a) easily damaged materials not used		P
	b) non-impregnated hygroscopic materials not used		P
6.9.3	Colour coding		—
	Green-and-yellow insulation shall not be used except:		—
	a) protective earth conductors;		N/A
	b) PROTECTIVE BONDING conductors;		N/A
	c) potential equalization conductors;		N/A
	d) functional earth conductors		N/A
6.10	Connection to MAINS supply source and connections between parts of equipment		—
6.10.1	MAINS supply cords		—
	RATED for maximum equipment current (see 5.1.3 c)		P
	Cable complies with IEC 60227 or IEC 60245	Approved Cable with Adaptor	P
	Heat-resistant if likely to contact hot parts		N/A
	Temperature RATING (cord and inlet)..... :		—
	Green/yellow used only for connection to PROTECTIVE CONDUCTOR TERMINALS		N/A
	Detachable cords with IEC 60320 MAINS connectors:		—
	Conform to IEC 60799; or		N/A
	Have the current RATING of the MAINS connector		N/A
6.10.2	Fitting of non-detachable MAINS supply cords		—
6.10.2.1	Cord entry		—
	a) inlet or bushing with a smoothly rounded opening; or		N/A
	b) insulated cord guard protruding >5 D (diameter)		N/A
6.10.2.2	Cord anchorage		—
	Protective earth conductor is the last to take the strain		N/A
	a) cord is not clamped by direct pressure from a screw		N/A
	b) knots are not used		N/A
	c) cannot push the cord into the equipment to cause a HAZARD		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	d) no failure of cord insulation in anchorage with metal parts		N/A
	e) not to be loosened without a tool		N/A
	f) cord replacement does not cause a HAZARD and method of strain relief is clear		N/A
	Push-pull and or torque test	(see Form A.19)	N/A
6.10.3	Plugs and connectors		—
	MAINS supply plugs, connectors etc., conform with relevant specifications		P
	If equipment supplied at voltages below 6.3.2.a) or from a sole source:		—
	Plugs of supply cords do not fit MAINS sockets above rated SUPPLY voltage		P
	MAINS type plugs used only for connection to MAINS supply		P
	Plug pins which receive a charge from an internal capacitor	(see Form A.5)	N/A
	Accessory MAINS socket outlets:		—
	a) marking if accepts a standard MAINS supply plug (see 5.1.3e)		N/A
	b) input has a protective earth conductor if outlet has EARTH TERMINAL CONTACT		N/A
6.11	Disconnection from supply source		P
6.11.1	Disconnects all current-carrying conductors		P
6.11.2	Exceptions		N/A
6.11.3	Requirements according to type of equipment		—
6.11.3.1	PERMANENTLY CONNECTED EQUIPMENT and multi-phase equipment		N/A
	Employs switch or circuit-breaker		N/A
	If switch or circuit-breaker is not part of the equipment, documentation requires:		—
	a) switch or circuit-breaker to be included in building installation		N/A
	b) suitable location easily reached		N/A
	c) marking as disconnecting for the equipment		N/A
6.11.3.2	Single-phase cord-connected equipment		P
	Equipment is provided with one of the following:		—
	a) switch or circuit-breaker		N/A
	b) appliance coupler (disconnectable without tool)		P
	c) separable plug (without locking device)		P
6.11.4	Disconnecting devices		N/A
6.11.4.1	Disconnecting device part of equipment		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Electrically close to the SUPPLY		N/A
	Power-consuming components not electrically located between the supply source and the disconnecting device		N/A
	Except electromagnetic interference suppression circuits permitted to be located on the supply side of the disconnecting device		N/A
6.11.4.2	Switches and circuit-breakers		N/A
	When used as disconnection device:		—
	Meets IEC 60947-1 and IEC 60947-3		N/A
	Marked to indicate function..... :		—
	Not incorporated in MAINS cord		N/A
	Does not interrupt PROTECTIVE EARTH CONDUCTOR		N/A
6.11.4.3	Appliance couplers and plugs		N/A
	Where an appliance coupler or separable plug is used as the disconnecting device (see 6.11.3.2):		—
	Readily identifiable and easily reached by the operator		N/A
	Single-phase portable equipment cord length not more than 3 m		N/A
	PROTECTIVE EARTH CONDUCTOR connected first and disconnected last		N/A

7	PROTECTION AGAINST MECHANICAL HAZARDS		—
7.1	Equipment does not cause a mechanical HAZARD in NORMAL nor in SINGLE FAULT CONDITION		P
	Conformity is checked by 7.2 to 7.7		P
7.2	Sharp edges		P
	Easily touched parts are smooth and rounded		P
	Do not cause injury during NORMAL USE and		P
	Do not cause injury during SINGLE FAULT CONDITION		P
7.3	Moving parts		N/A
7.3.1	HAZARDS from moving parts limited to a tolerable level with the conditions specified in 7.3.2 and 7.3.5		N/A
	RISK assessment in accordance with 7.3.3 carried out		N/A
7.3.2	Exceptions		N/A
	Access to HAZARDOUS moving parts permitted under following circumstances:		—
	a) obviously intended to operate on parts or materials external of the equipment		N/A
	inadvertent touching of moving parts minimized by equipment design (e .g. guards or handles)		N/A




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	b) If OPERATOR access is unavoidable outside NORMAL USE following precautions have been taken:		—
	1) access requires TOOL		N/A
	2) statement about training in the instructions		N/A
	3) warning markings on covers prohibiting access by untrained OPERATORS		N/A
	or symbol 14 with full details in documentation		N/A
7.3.3	RISK assessment for mechanical HAZARDS to body parts		N/A
	Risk is reduced to a tolerable level by protective measures as specified in table 12		N/A
	Minimum protective measures:		—
	A. Low level measures		N/A
	B. Moderate measures		N/A
	C. Stringent measures		N/A
7.3.4	Limitation of force and pressure	(see Form A.20)	N/A
	Following levels are met in NORMAL and SINGLE FAULT CONDITION:	No such hazard	—
	Continuous contact pressure below 50 N / cm ² with force below 150 N		N/A
	Temporary force below 250 N for an area at least of 3 cm ² for a maximum duration of 0,75 s		N/A
7.3.5	Gap limitations between moving parts	(see Form A.20)	N/A
7.3.5.1	Access normally allowed		—
	If levels of 7.3.4 exceeded and body part may be inserted minimum gap as specified in table 13 assured in NORMAL and in SINGLE FAULT CONDITION		N/A
7.3.5.2	Access normally prevented		—
	Maximum gap as specified in table 14 assured in NORMAL and in SINGLE FAULT CONDITION		N/A
7.4	Stability		—
	Equipment not secured to building structure is physical stable		N/A
	Stability maintained after opening of drawers etc. by automatic means, or		N/A
	warning marking requires the application of means		N/A
	Compliance checked by following tests as applicable:		—
	a) 10° tilt test for other than handheld equipment		P
	b) multi-directional force test for equipment exceeds height of 1 m and mass of 25 kg		N/A
	c) downward force test for floor-standing equipment		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	d) overload test with 4 times maximum load for castor or support that supports greatest load		N/A
	e) castor or support that supports greatest load removed from equipment		N/A
7.5	Provisions for lifting and carrying		—
7.5.1	Equipment more than 18 kg :		—
	Has means for lifting or carrying; or		N/A
	Directions in documentation		N/A
7.5.2	Handles and grips		—
	Handles or grips withstand four times weight		N/A
7.5.3	Lifting devices and supporting parts		—
	RATED for maximum load; or		N/A
	tested with four times maximum static load		N/A
7.6	Wall mounting		—
	Mounting brackets withstand four times weight		N/A
7.7	Expelled parts		—
	Equipment contains or limits the energy		N/A
	Protection not removable without the aid of a tool		N/A

8	RESISTANCE TO MECHANICAL STRESSES		—
8.1	Equipment does not cause a HAZARD when subjected to mechanical stresses in NORMAL USE		P
	Normal protection level is 5 J		P
	Levels below 5 J but not less than 1 J are acceptable if all of following criteria are met:		—
	a) lower level justified by RISK assessment of manufacturer		N/A
	b) equipment installed in its intended application is not easily touched		N/A
	c) only occasional access during NORMAL USE		N/A
	d) IK code in accordance to IEC 62262 marked or symbol 14 used with full information in the documentation		N/A
	for non-metallic ENCLOSURES rated below 2 °C ambient temperature value chosen for minimum RATED temperature		N/A
	impact energies between IK values, the IK code marked for nearest lower value		N/A
	Conformity is checked by performing following tests:		—
	1) static test of 8.2.1	No hazard	P
	2) impact test of 8.2.2 with 5 J except for HAND-HELD EQUIPMENT		P




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	if impact energy not selected to 5 J alternate method of IEC 62262 used		N/A
	3) drop test of 8.3.1 or 8.3.2 except for FIXED EQUIPMENT and equipment with mass over 100 kg		N/A
	Equipment RATED with an impact rating of IK 08 that obviously meets the criteria		P
	After the tests inspection with following results:		—
	– HAZARDOUS LIVE parts above the limits of 6.3.2 not ACCESSIBLE		P
	– insulation pass the voltage tests of 6.8	(see Form A.30)	P
	i) no leaks of corrosive and harmful substances		P
	ii) ENCLOSURE shows no cracks resulting in a HAZARD		P
	iii) CLEARANCES not less than their permitted values		P
	iv) insulation of internal wiring remains undamaged		P
	v) PROTECTIVE BARRIERS not damaged or loosened		P
	vi) No moving parts exposed, except permitted by 7.3		P
	vii) no damage which could cause spread of fire		P
8.2	ENCLOSURE rigidity test		—
8.2.1	Static test	(see Form A.21A)	—
	– 30 N with 12 mm rod to each part of ENCLOSURE		P
	– in case of doubt test conducted at maximum RATED ambient temperature	No such doubt	N/A
8.2.2	Impact test	(see Form A.21A)	—
	Impact applied to any part of ENCLOSURE causing a HAZARD if damaged		P
	Impact energy level and corresponding IK code	IK08	—
	Non-metallic ENCLOSURES cooled to minimum RATED ambient temperature if below 2 °C		N/A
8.3	Drop test	(see Form A.21B)	—
8.3.1	Other than HAND-HELD and DIRECT-PLUG-IN EQUIPMENT		P
	Tests conducted with a drop height or angle of	Angle of 30 °C	—
8.3.2	HAND-HELD and DIRECT-PLUG-IN EQUIPMENT		—
	Non-metallic ENCLOSURES cooled to minimum RATED ambient temperature if below 2 °C	Fixed equipment	N/A
	Drop test conducted with an height of 1 m		N/A
9	PROTECTION AGAINST THE SPREAD OF FIRE		—
9.1	No spread of fire in NORMAL and SINGLE FAULT CONDITION		P




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	MAINS supplied equipment meets requirements of 9.6 additionally		N/A
	Conformity is checked by minimum one or a combination of the following (see Figure 11):	(see Form A.22)	—
	a) SINGLE FAULT test of 4.4; or	(see Form A.1)	P
	b) Application of 9.2 (eliminating or reducing the sources of ignition); or		N/A
	c) Application of 9.3 (containment of fire within the equipment)		N/A
9.2	Eliminating or reducing the sources of ignition within the equipment		—
	a) 1) Limited-energy circuit (see 9.4); or		P
	b) 2) BASIC INSULATION provided for parts of different potential; or	(see Form A.14 and A.18)	P
	Bridging the insulation does not cause ignition	(see Form A.1)	—
	c) Surface temperature of liquids and parts (see 9.5)		N/A
	d) No ignition in circuits designed to produce heat	(see Form A.1)	N/A
9.3	Containment of the fire within the equipment, should it occur		—
9.3.1	Spread of fire outside equipment reduced to a tolerable level if:		—
	a) Energizing of the equipment is controlled by an OPERATOR held switch		N/A
	b) ENCLOSURE is conform with constructional requirements of 9.3.2; and		N/A
	Requirements of 9.5 are met		N/A
9.3.2	Constructional requirements		—
	a) Connectors and insulating material have flammability classification V-2 or better	(see TABLE 1 or Form A.23)	N/A
	b) Insulated wires and cables are flame retardant (VW-1 or equivalent)	(see TABLE 1 or Form A.23)	N/A
	c) ENCLOSURE meets following requirements:	(see Form A.22)	—
	1) Bottom and sides in arc of 5 ° (see Figure 13) to non-limited circuits (9.4) meets:		—
	i) no openings; or		N/A
	ii) perforated as specified in table 16; or		N/A
	iii) metal screen with a mesh; or		N/A
	iv) baffles as specified in Figure 12		N/A
	2) Material of ENCLOSURE and any baffle or flame barrier is made of:		—
	Metal (except magnesium); or		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Non-metallic materials have flammability classification V-1 or better	(see TABLE 1 or Form A.22)	N/A
	3) ENCLOSURE and any baffle or flame barrier have adequate rigidity		N/A
9.4	Limited-energy circuit	(see Form A.24)	—
	a) Potential not more than 30 r.m.s. and 42,4 V peak, or 60 V dc		P
	b) Current limited by one of following means:		—
	1) Inherently or by impedance (see table 17); or		N/A
	2) Overcurrent protective device (see table 18); or		N/A
	3) A regulating network limits also in SINGLE FAULT CONDITION (see table 17)		N/A
	c) Is separated by at least BASIC INSULATION		—
	Fuse or a nonadjustable electromechanical device is used		N/A
9.5	Requirements for equipment containing or using flammable liquids		—
	Flammable liquids contained in or specified for use with equipment do not cause spread of fire	(see Form A.25)	N/A
	RISK is reduced to a tolerable level:		—
	a) The temperature of surface or parts in contact with flammable liquids is 25 °C below fire point		N/A
	b) The quantity of liquid is limited		N/A
	c) Flames are contained within the equipment		N/A
	Detailed instructions for RISK-reduction provided		N/A
9.6	Overcurrent protection		—
9.6.1	MAINS supplied equipment protected		—
	BASIC INSULATION between MAINS parts of opposite polarity provided	(see Form A.14 and A.15)	N/A
	Devices not in the protective conductor		N/A
	Fuses or single-pole circuit-breakers not fitted in neutral (multi-phase)		N/A
9.6.2	PERMANENTLY CONNECTED EQUIPMENT		—
	Overcurrent protection device:		—
	Fitted within the equipment; or		N/A
	Specified in manufacturer's instructions		N/A
9.6.3	Other equipment		—
	Protection within the equipment		N/A




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
10	EQUIPMENT TEMPERATURE LIMITS AND RESISTANCE TO HEAT		—
10.1	Surface temperature limits for protection against burns		—
	Easily touched surfaces within the limits in NORMAL and in SINGLE FAULT CONDITION:	(see Form A.26A)	—
	– at an specified ambient temperature of 40 °C		N/A
	– for equipment rated above 40 °C ambient temperature limits not exceeded raised by the difference to 40 °C		P
	Heated surfaces necessary for functional reasons exceeding specified values:		—
	– Are recognizable as such by appearance or function; or		N/A
	– Are marked with symbol 13		N/A
	– Guards are not removable without tool		N/A
10.2	Temperatures of windings		N/A
	Limits not exceeded in:	(see Form A.26B)	—
	NORMAL CONDITION		N/A
	SINGLE FAULT CONDITION		N/A
10.3	Other temperature measurements		—
	Following measurements conducted if applicable:	(see Form A.26A)	—
	a) Value of 60 °C of field-wiring terminal box not exceeded		N/A
	b) Surface of flammable liquids and parts in contact with this liquids		N/A
	c) Surface of non-metallic ENCLOSURES	No increase of temperature	P
	d) Parts made of insulating material supporting parts connected to MAINS supply	Approved adaptor	P
	e) Terminals carrying a current more than 0,5 A		N/A
10.4	Conduct of temperature tests		—
10.4.1	Tests conducted under reference test conditions and manufacturer's instructions	(see Form A.26A)	P
10.4.2	Temperature measurement of heating equipment		—
	Tests conducted in test corner	(see Form A.26A)	—
10.4.3	Equipment intended for installation in a cabinet or wall		—
	Equipment built in as specified in installation instructions	(see Form A.26A)	N/A
10.5	Resistance to heat		—
10.5.1	Integrity of CLEARANCE and CREEPAGE DISTANCES	(see Form A.16) Non-metallic enclosures	P
10.5.2	Non-metallic ENCLOSURES	(see Form A.27)	P
	Within 10 min after treatment:		—




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Equipment subjected to suitable stresses of 8.2 and 8.3 complying with criteria of 8.1		P
10.5.3	Insulating material		—
	a) Parts supporting parts connected to MAINS supply		N/A
	b) TERMINALS carrying a current more than 0,5 A		N/A
	Examination of material data; or		N/A
	in case of doubt:		—
	1) Ball pressure test; or	(see Form A.28)	N/A
	2) Vicat softening test of ISO 306	(see Form A.29)	N/A

11	PROTECTION AGAINST HAZARDS FROM FLUIDS		—
11.1	Protection to OPERATORS and surrounding area provided by EQUIPMENT		N/A
	All fluids specified by manufacturer considered		N/A
11.2	Cleaning	(see Form A.30)	N/A
11.3	Spillage	(see Form A.30)	N/A
11.4	Overflow	(see Form A.30)	N/A
11.5	Battery electrolyte		—
	Battery electrolyte leakage presents no HAZARD		N/A
11.6	Specially protected equipment	(see Form A.30)	N/A
11.7	Fluid pressure and leakage		N/A
11.7.1	Maximum pressure.....:	(see Form A.31)	—
	Maximum pressure of any part does not exceed P_{RATED}		N/A
11.7.2	Leakage and rupture at high pressure		—
	Fluid-containing parts subjected to hydraulic test if.....:	(see Form A.31)	—
	a) product of pressure and volume > 200 kPa; and		N/A
	b) pressure > 50 kPa		N/A
	Parts of refrigerating systems meets pressure-related requirements of IEC 60335-24 or IEC 60335-2-89		N/A
11.7.3	Leakage from low-pressure parts	(see Form A.32)	N/A
11.7.4	Overpressure safety device		N/A
	Does not operate in NORMAL USE		N/A
	a) Connected as close as possible to parts intended to be protected		N/A
	b) Easy access for inspection, maintenance and repair		N/A
	c) Adjustment only with TOOL		N/A




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	d) No discharge towards person		N/A
	e) No HAZARD from deposit of discharged material		N/A
	f) Adequate discharge capacity		N/A
	No shut-off valve between overpressure safety device and protected parts		N/A

12	PROTECTION AGAINST RADIATION, INCLUDING LASER SOURCES, AND AGAINST SONIC AND ULTRASONIC PRESSURE		—
12.1	Equipment provides protection		N/A
12.2	Equipment producing ionizing radiation		N/A
12.2.1	Ionizing radiation	(see Form A.33)	N/A
12.2.1.1	Equipment meets the following requirements:		—
	a) if intended to emit radiation meets requirements of 12.2.1.2; or		N/A
	tested, classified and marked in accordance to IEC 60405		N/A
	b) if only emits stray radiation meets requirements of 12.2.1.3		N/A
12.2.1.2	Equipment intended to emit radiation		—
	Effective dose rate of radiation measured..... :		—
	If dose rate exceeds 5 $\mu\text{Sv/h}$ marked with the following:		—
	a) symbol 17 (ISO 361)		N/A
	b) abbreviations of the radionuclides		—
	c) with maximum dose at 1 m; or..... :		—
	with dose rate value between 1 $\mu\text{Sv/h}$ and 5 $\mu\text{Sv/h}$ in m		—
12.2.1.3	Equipment not intended to emit radiation	(see Form A.34)	—
	Limit for unintended stray radiation of 1 $\mu\text{Sv/h}$ at any easily reached point kept		—
12.2.2	Accelerated electrons		—
	Compartments opened only by the use of a TOOL		N/A
12.3	Ultraviolet (UV) radiation		N/A
	No unintentional HAZARDOUS escape of UV radiation:		—
	– checked by inspection; and		N/A
	– evaluation of RISK assessment documentation		N/A
12.4	Microwave radiation		N/A
	Power density does not exceed 10 W/m^2		N/A
12.5	Sonic and ultrasonic pressure		N/A
12.5.1	Sound level	(see Form A.35)	—




IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	No HAZARDOUS sound emission		N/A
	Maximum sound pressure level measured and calculated for maximum sound power level as specified in ISO 3746 or ISO 9614-1		N/A
	Instruction describes measures for protection		N/A
12.5.2	Ultrasonic pressure	(see Form A.36)	N/A
	Equipment not intended to emit ultrasound does not exceed limit of 110 dB between 20 kHz and 100 kHz		N/A
	Equipment intended to emit ultrasound:		N/A
	Outside useful beam does not exceed limit of 110 dB between 20 kHz and 100 kHz		N/A
	If inside useful beam above values exceeded:		—
	Marked with Symbol 14 of table 1		N/A
	and following information in the documentation:		—
	a) dimensions of useful beam		N/A
	b) area where ultrasonic pressure exceed 110 dB		N/A
	c) maximum sound pressure inside beam area		N/A
12.6	Laser sources		N/A
	Equipment meets requirements of IEC 60825-1		N/A

13	PROTECTION AGAINST LIBERATED GASES AND SUBSTANCES, EXPLOSION AND IMPLOSION		—
13.1	Poisonous and injurious gases and substances		N/A
	No poisonous or injurious gases or substances liberated in NORMAL CONDITION		N/A
	Attached data/test reports demonstrate conformity		N/A
13.2	Explosion and implosion		N/A
13.2.1	Components		N/A
	Components liable to explode:		—
	Pressure release device provided; or		N/A
	Apparatus incorporates operator protection (see also 7.7)		N/A
	Pressure release device:		—
	Discharge without danger		N/A
	Cannot be obstructed		N/A
13.2.2	Batteries and battery charging	(see Form A.37)	—
	If explosion or fire HAZARD could occur:		—
	Protection incorporated in the equipment; or		N/A
	Instructions specify batteries with built-in protection		N/A
	In case of wrong type of battery used:		—



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	No HAZARD; or		N/A
	Warning by marking and within instructions		N/A
	Equipment with means to charge rechargeable batteries:		—
	Warning against the charging of non-rechargeable batteries; and		N/A
	Type of rechargeable battery indicated; or		N/A
	Symbol 14 used		N/A
	Battery compartment design		N/A
	Single component failure		N/A
	Polarity reversal test		N/A
13.2.3	Implosion of cathode ray tubes		N/A
	If maximum face dimensions > 160 mm		—
	Intrinsically protected and correctly mounted; or		N/A
	ENCLOSURE provides protection:		N/A
	If non-intrinsically protected:		—
	Screen not removable without TOOL		N/A
	If glass screen, not in contact with surface of tube		N/A

14	COMPONENTS AND SUBASSEMBLIES		—
14.1	Where safety is involved, components and subassemblies meet relevant requirements	(see TABLE 1)	P
14.2	Motors		N/A
14.2.1	Motor temperatures		N/A
	Does not present a HAZARD when stopped or prevented from starting; or	(see Form A.1; A.26B)	N/A
	Protected by over-temperature or thermal protection device conform with 14.3		N/A
14.2.2	Series excitation motors		N/A
	Connected direct to device, if overspeeding causes a HAZARD		N/A
14.3	Overtemperature protection devices		N/A
	Devices operating in a SINGLE FAULT CONDITION	(see Form A.38)	N/A
	a) Reliable function is ensured		N/A
	b) RATED to interrupt maximum current and voltage		N/A
	c) Does not operate in NORMAL USE		N/A
	If self-resetting device used to prevent a HAZARD, protected part requires intervention before restarting		N/A
14.4	Fuse holders	No fuse	N/A
	No access to HAZARDOUS LIVE parts		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
14.5	MAINS voltage selecting devices		N/A
	Accidental change not possible		N/A
14.6	MAINS transformers tested outside equipment	(see Form A.39 and A.40)	N/A
14.7	Printed circuit boards		N/A
	Data shows conformity with V-1 of IEC 60695-11-10 or better; or		N/A
	Test shows conformity with V-1 of IEC 60695-11-10 or better	(see Form A.23)	N/A
	Not applicable for printed wiring boards with limited-energy circuits (9.4)		N/A
14.8	Circuits or components used as TRANSIENT OVERVOLTAGE limiting devices		N/A
	Test conducted between each pair of MAINS SUPPLY TERMINALS	(see Form A.41)	N/A
	No HAZARD resulting from rupture or overheating of the component:		—
	– no bridging of safety relevant insulation		N/A
	– no heat to other parts above the self-ignition points		N/A

15	PROTECTION BY INTERLOCKS		—
15.1	Interlocks are designed to remove a HAZARD before OPERATOR exposed		N/A
15.2	Prevention of reactivation		N/A
15.3	Reliability		N/A
	Single fault unlikely to occur; or		N/A
	Cannot cause a HAZARD		N/A


16	HAZARDS RESULTING FROM APPLICATION		—
16.1	REASONABLY FORESEEABLE MISUSE		N/A
	No HAZARDS arising from settings not intended and not described in the instructions		N/A
	Other cases of REASONABLY FORESEEABLE MISUSE addressed by RISK assessment		N/A
16.2	Ergonomic aspects		N/A
	Factors giving rise to a HAZARD the RISK assessment is reflecting those aspects:		—
	a) limitation of body dimensions		N/A
	b) displays and indicators		N/A
	c) accessibility and conventions of controls		N/A
	d) arrangement of TERMINALS		N/A



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
17	RISK ASSESSMENT		—
	RISK assessment conducted, if HAZARD might arise and not covered by Clauses 6 to 16		P
	TOLERABLE RISK achieved by iterative documented process covering the following:		—
	a) RISK analysis		P
	Identifies HAZARDS and estimates RISK		P
	b) RISK evaluation		P
	Plan to judge acceptability of resulting RISK level based on the estimated severity and likelihood of a RISK		P
	c) RISK reduction		P
	Initial RISK reduced by counter measures;		P
	Repeated RISK evaluation without new RISKS introduced		P
	RISKS remaining after RISK assessment addressed in instructions to RESPONSIBLE BODY:		—
	Information contained how to mitigate these RISKS		P
	Following principles in methods of RISK reduction applied by manufacturer in given order:		—
	1) RISKS eliminated or reduced as far as possible		P
	2) Protective measures taken for RISKS that cannot be eliminated		P
	3) User information about residual RISK due to any defect of the protective measures		P
	Indication of particular training is required		P
	Specification of the need for personal protective equipment		N/A
	Conformity checked by evaluation of the RISK assessment documentation		P

ANNEX F	ROUTINE TESTS		—
	Manufacturer 's declaration		N/A

ANNEX H	QUALIFICATION OF CONFORMAL COATINGS FOR PROTECTION AGAINST POLLUTION		—
H.1	General		N/A
	Conformal coatings meet the requirements of Clause H.2 and H.3.		N/A
H.2	Technical properties		N/A
	Technical properties of conformal coatings are suitable for the intended application. In particular:		—



IEC 61010-1			
Clause	Requirement + Test	Result - Remark	Verdict
	a) Manufacturer indicate that it is a coating for PWBs;		N/A
	b) RATED operating temperature include the temperature range of the indicated application;		N/A
	c) CTI, insulation resistance and dielectric strength are suitable for the intended application;		N/A
	d) Coating have adequate UV resistance, if it is exposed to sunlight;		N/A
	e) Flammability RATING of the coating is at least the required flammability RATING of the applied PWB.		N/A
H.3	Qualification of coatings	(see Form A.42)	N/A
	Coating complies with the conformity requirements.		N/A

